

Upgrade

General Features

The Upgrade grinder pump is engineered to fit into virtually any grinder pump wetwell. Universal design allows easy drop-in conversion, ready to connect. The Upgrade is a complete replacement for all of the troublesome components of a centrifugal pump station, including the old unit's slide rails, pump/motor, float switches, piping, and motor control devices.

- Designed not to jam and for minimum wear to the grinding mechanism
- Retrofit simplex or larger stations
- Available with a range of discharge hose lengths to accommodate a wide range of tank depths

The Upgrade comes complete with a self-contained level control system, eliminating troublesome float switches. The internal check valve assembly located on the grinder pump is custom designed for non-clog, trouble-free operation. The Upgrade uses a cable that connects the motor controls to the level controls through watertight penetrations.

Operational Information

Motor

1 hp, 1,725 rpm, high torque, capacitor start, thermally protected, 120/240V, 60 Hz, 1 phase

Discharge Connections

Pump discharge terminates in 1.25-inch female solvent weld fitting; threaded adapter is supplied and discharge can easily be adapted to 1.25-inch NPT.

Discharge


15 gpm at 0 psig (0.95 lps at 0 m)
11 gpm at 40 psig (0.69 lps at 28 m)
7.8 gpm at 80 psig (0.49 lps at 56 m)


Accessories

E/One recommends that the Uni-Lateral, E/One's own stainless steel check valve, be installed between the grinder pump station and the street main for added protection against backflow.

Alarm panels are available with a variety of options, from basic monitoring to advanced notice of service requirements.

The Remote Sentry is ideal for installations where the alarm panel may be hidden from view.

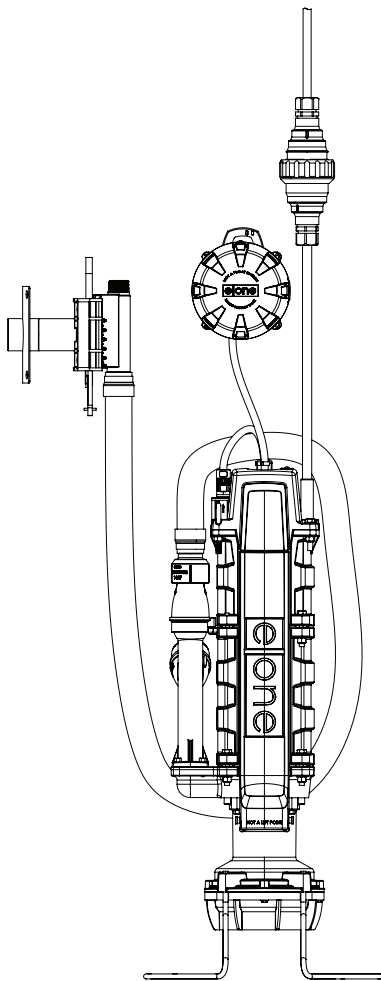

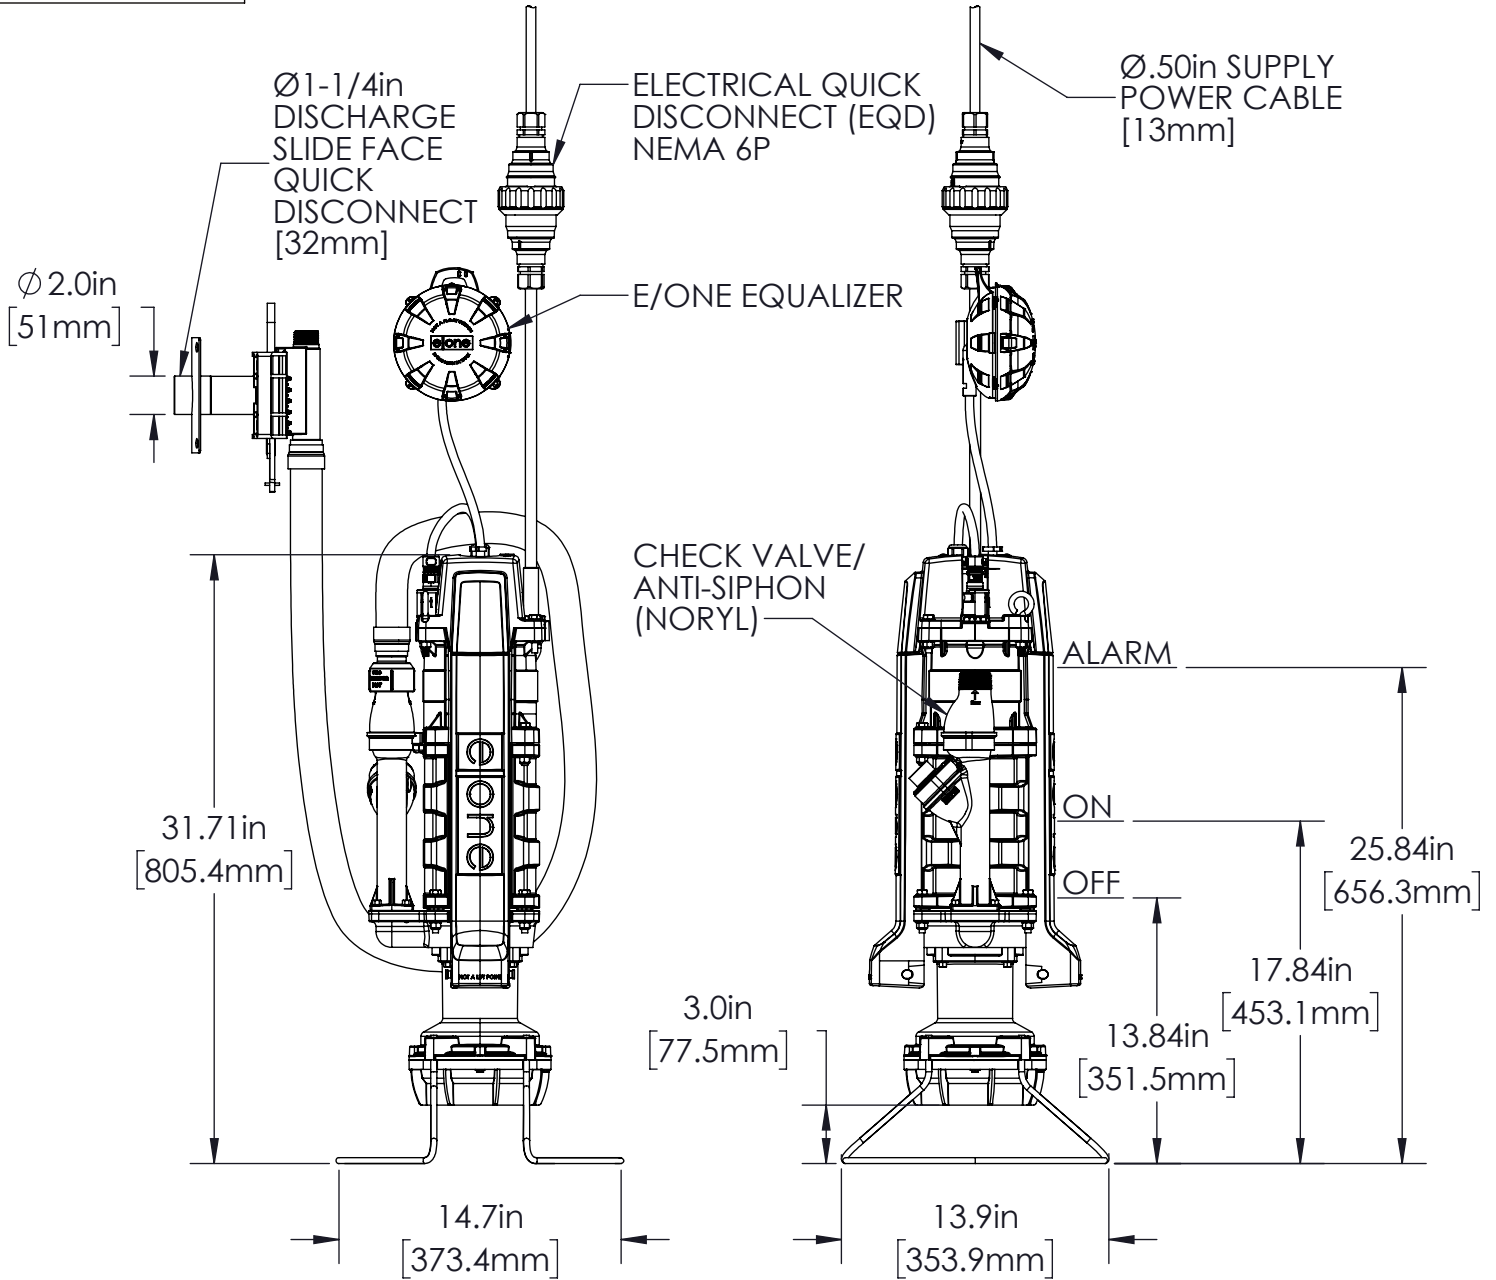

UPGRADE GRINDER PUMP


MAL	JVL	5/13/2026	D	1:10
DR BY	CHK'D	DATE	ISSUE	SCALE



DIMENSION SHEET, UPGRADE

NA0055P02

TYPICAL SIMPLEX UPGRADE INSTALLATION

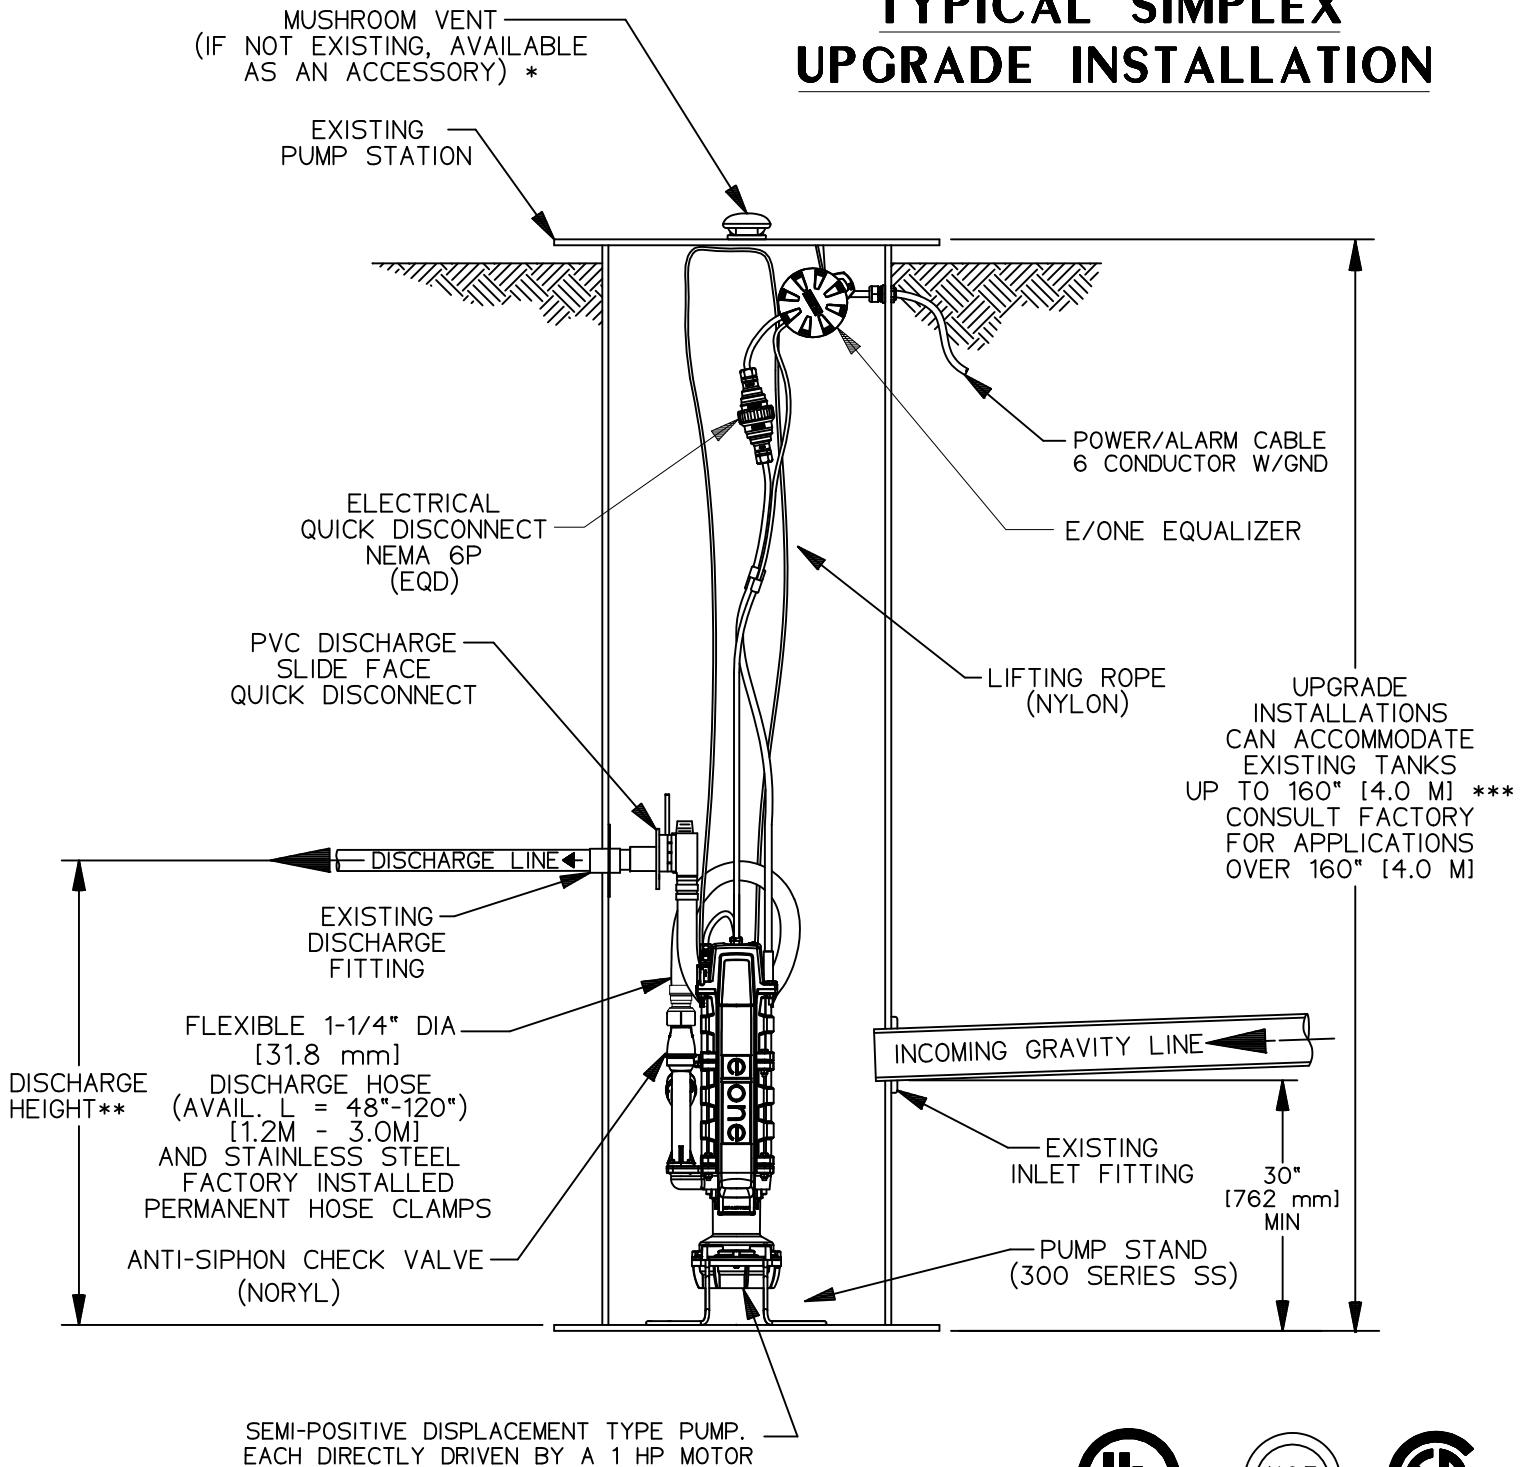

CTT	JVL	03/10/25	D	.063
DR BY	CHK'D	DATE	ISSUE	SCALE



DETAIL SHEET, UPGRADE SIMPLEX


NA0055P04

* STATION MUST BE VENTED

** DISCHARGE HEIGHT MUST BE KNOWN WITHIN 1 FOOT [0.3 M]
TO ORDER PROPER KIT

*** TANK HEIGHT MUST NOT BE GREATER THAN 160 INCHES [4.0 M]

TYPICAL DUPLEX UPGRADE INSTALLATION

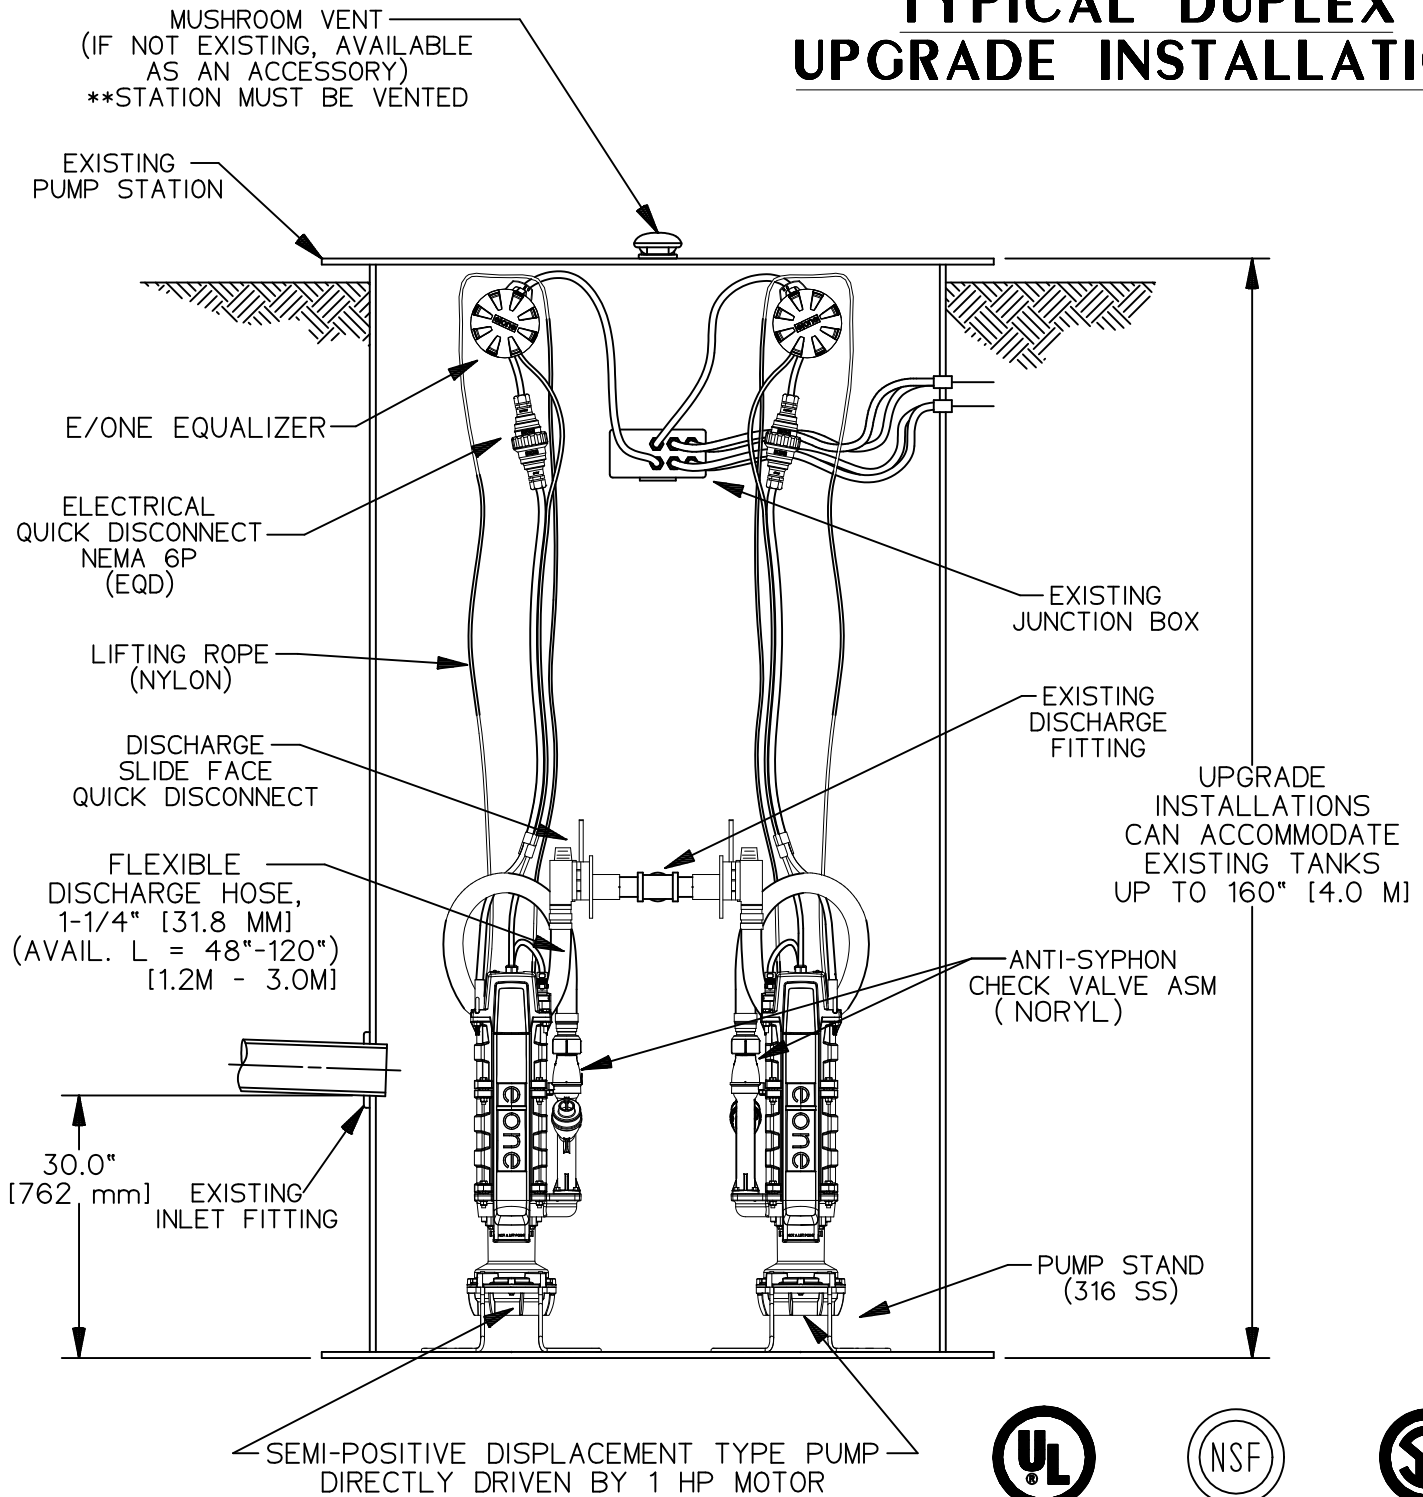

LNT	JVL	03/11/25	B	.063
DR BY	CHK'D	DATE	ISSUE	SCALE



DETAIL SHEET, UPGRADE DUPLEX
TYPICAL DROP-IN EXISTING STATION

NA0055P05